



TEST REPORT EN 1154 Building hardware- Controlled door closing devices -Requirements and test methods							
Report Reference No.....:	130401045GZU-001						
Tested by (name and signature).....:	Alan Lai <i>Alan Lai</i>						
Approved by (name and signature) ...:	Blusea Dong <i>Blusea Dong</i>						
Date of issue.....:	July 5, 2013						
Contents	Total test report 11 pages including: Report text: 6 pages Appendix A for product photo: 1 page Appendix B for product drawing and bill of material: 1 page Appendix C for installation instruction: 2 pages Revision page 1 page						
Testing Laboratory name	Intertek Testing Services Shenzhen Ltd. Guangzhou Branch						
Address.....:	Block E, No.7-2 Guang Dong Software Science Park, Caipin Road, Guangzhou Science City, GETDD, Guangzhou, China						
Testing location.....:	Same as above						
Applicant's name.....:							
Address.....:							
Test specification							
Standard	EN 1154:1996/A1:2002/AC:2006						
Non-standard test method	None						
Test Report Form No.....:	TTRF EN 1154: 1997 A						
TTRF Originator.....:	Intertek Testing Services Shenzhen Ltd. Guangzhou Branch						
Master TTRF.....:	Dated 2008-01						
Test Item description	Concealed floor spring for glass door						
Trade Mark							
Model and/or type reference.....:							
Manufacturer							
Rating(s)	<table border="1" style="display: inline-table;"> <tr> <td style="width: 20px; text-align: center;">3</td> <td style="width: 20px; text-align: center;">8</td> <td style="width: 20px; text-align: center;">3</td> <td style="width: 20px; text-align: center;">0</td> <td style="width: 20px; text-align: center;">1</td> <td style="width: 20px; text-align: center;">3</td> </tr> </table>	3	8	3	0	1	3
3	8	3	0	1	3		
Summary of testing							
The submitted samples COMPLIED WITH all applicable mechanical performance requirements of EN 1154:1996/A1:2002/AC:2006 for the ratings.							

TTRF EN 1154: 1997 A
 Originator: Intertek Testing Services Shenzhen Ltd. Guangzhou Branch

Test item particulars	
Classification of installation and use	For all internal and external doors for use by the public, and others with little incentive to take care.
Test case verdicts	
Test case does not apply to the test object.....	N/A
Test item does meet the requirement	P (Pass)
Test item does not meet the requirement	F (Fail)
Testing	
Date of receipt of test item	March 29, 2013
Date(s) of performance of test	April 1, 2013 to June 27, 2013
General remarks	
<p>This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.</p> <p>"(See remark #)" refers to a remark appended to the report. "(See Appendix #)" refers to an appendix appended to the report. Throughout this report a comma (point) is used as the decimal separator.</p> <p><u>When determining the test result, measurement uncertainty has been considered.</u></p>	
General product information:	
Concealed floor spring for glass door, model:	double action with power size 3;
Maximum opening angle:	150° ;
Function:	two adjustable valves for speed control and latch control;
This model has optional 'Hold-open' function, and the test data was based on the one without hold-open function.	
* Such closing device with fixed mechanical hold-pen is not allowed to use on fire/smoke door assemblies.	
Schedule of Components:	
See Appendix B – product drawing and bill of material.	
Detail "Ratings" information listed as following:	
First digit (Category of use):	Grade 3 - for closing doors from at least 105° open;
Second digit (Durability):	Grade 8 - 500 000 test cycles;
Third digit (Door closer power size):	Grade 3 - power size 3;
Fourth digit (suitability for use on fire/smoke doors):	Grade 0 - not suitable for use on fire/smoke door assemblies;
Fifth digit (Safety):	Grade 1 - all door closers are required to satisfy the essential requirement of safety in use;
Sixth digit (Corrosion resistance):	Grade 3 - high resistance.

EN 1154																																																																					
Clause	Requirement – Test		Result - Remark			Verdict																																																															
4	CLASSIFICATION					—																																																															
4.1	Door closer shall be classified by six digit coding system:					—																																																															
4.2	Category of use:		3			—																																																															
4.3	Durability:		8			—																																																															
4.4	Door closer power size:		3			—																																																															
4.5	Suitability for use on fire/smoke doors:		0			—																																																															
4.6	Safety:		1			—																																																															
4.7	Corrosion resistance:		3			—																																																															
5	REQUIREMENTS					—																																																															
5.1	<p>Product information</p> <p>A door closer manufactured to this standard shall be supplied with clear, detailed instructions for its installation, regulation and maintenance, which shall include any limitations of opening angle.</p> <p>Where a door closer is recommended for fitting in other than a standard application, these instructions shall clearly define the door closer power size for each application of fitting position stated.</p>		<p>Detail instruction information was provided in the Product Instruction</p> <p>Power size 3 and relevant recommended door specification were list in the installation instruction.</p> <p>Maximum opening: 150°.</p>			P																																																															
5.2	<p>Performance</p> <table border="1"> <thead> <tr> <th rowspan="3">Door closer Power size</th> <th colspan="3">Closing moment</th> <th rowspan="3">Opening moment 0° to 60°</th> <th rowspan="3">Door closer efficiency 0° to 4°</th> </tr> <tr> <th colspan="2">0° to 4°</th> <th>88° to 92°</th> <th>Any other angle</th> </tr> <tr> <th>Nm min.</th> <th>Nm max.</th> <th>Nm min.</th> <th>Nm min.</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>9</td> <td><13</td> <td>3</td> <td>2</td> <td>26</td> <td>50</td> </tr> <tr> <td>2</td> <td>13</td> <td><18</td> <td>4</td> <td>3</td> <td>36</td> <td>50</td> </tr> <tr> <td>3</td> <td>18</td> <td><26</td> <td>6</td> <td>4</td> <td>47</td> <td>55</td> </tr> <tr> <td>4</td> <td>26</td> <td><37</td> <td>9</td> <td>6</td> <td>62</td> <td>60</td> </tr> <tr> <td>5</td> <td>37</td> <td><54</td> <td>12</td> <td>8</td> <td>83</td> <td>65</td> </tr> <tr> <td>6</td> <td>54</td> <td><87</td> <td>18</td> <td>11</td> <td>134</td> <td>65</td> </tr> <tr> <td>7</td> <td>87</td> <td><140</td> <td>29</td> <td>18</td> <td>215</td> <td>65</td> </tr> </tbody> </table>					Door closer Power size	Closing moment			Opening moment 0° to 60°	Door closer efficiency 0° to 4°	0° to 4°		88° to 92°	Any other angle	Nm min.	Nm max.	Nm min.	Nm min.	1	9	<13	3	2	26	50	2	13	<18	4	3	36	50	3	18	<26	6	4	47	55	4	26	<37	9	6	62	60	5	37	<54	12	8	83	65	6	54	<87	18	11	134	65	7	87	<140	29	18	215	65	—
Door closer Power size	Closing moment			Opening moment 0° to 60°	Door closer efficiency 0° to 4°																																																																
	0° to 4°		88° to 92°				Any other angle																																																														
	Nm min.	Nm max.	Nm min.			Nm min.																																																															
1	9	<13	3	2	26	50																																																															
2	13	<18	4	3	36	50																																																															
3	18	<26	6	4	47	55																																																															
4	26	<37	9	6	62	60																																																															
5	37	<54	12	8	83	65																																																															
6	54	<87	18	11	134	65																																																															
7	87	<140	29	18	215	65																																																															
5.2.1	<p>General</p> <p>When tested in accordance with clauses 6 and 7, the door closer shall satisfy the relevant performance requirements of 5.2.2 to 5.2.11, and 5.2.12 to 5.2.18 as appropriate:</p>		See below clauses			P																																																															

EN 1154																													
Clause	Requirement – Test	Result - Remark			Verdict																								
5.2.2	<p>Durability</p> <p>The door closer shall be able to close a test door conforming to 6.1.1 and 6.2 from an opening angle of 90°, for a minimum of 500,000 test cycles:</p>	250 000 test cycles in each direction			P																								
5.2.3	<p>Closing moment</p> <p>After 5000 test cycles and after 500,000 test cycles the measured closing moments shall be not less than the value stated in Table 1:</p>	<p>After 5000 test cycles</p> <table border="1"> <tr> <td>Rotating direction</td> <td>CW</td> <td>CCW</td> </tr> <tr> <td>Maximum closing moment (0°~ 4°), Nm</td> <td>25,2</td> <td>24,8</td> </tr> <tr> <td>Maximum closing moment (88°~ 92°), Nm</td> <td>14,6</td> <td>14,8</td> </tr> <tr> <td>Minimum closing moment at any other angle, Nm</td> <td>8,6</td> <td>8,8</td> </tr> </table> <p>After 500,000 test cycles</p> <table border="1"> <tr> <td>Rotating direction</td> <td>CW</td> <td>CCW</td> </tr> <tr> <td>Maximum closing moment (0°~ 4°), Nm</td> <td>22,0</td> <td>21,9</td> </tr> <tr> <td>Maximum closing moment (88°~ 92°), Nm</td> <td>11,0</td> <td>11,2</td> </tr> <tr> <td>Minimum closing moment at any other angle, Nm</td> <td>6,3</td> <td>6,5</td> </tr> </table>			Rotating direction	CW	CCW	Maximum closing moment (0°~ 4°), Nm	25,2	24,8	Maximum closing moment (88°~ 92°), Nm	14,6	14,8	Minimum closing moment at any other angle, Nm	8,6	8,8	Rotating direction	CW	CCW	Maximum closing moment (0°~ 4°), Nm	22,0	21,9	Maximum closing moment (88°~ 92°), Nm	11,0	11,2	Minimum closing moment at any other angle, Nm	6,3	6,5	P
Rotating direction	CW	CCW																											
Maximum closing moment (0°~ 4°), Nm	25,2	24,8																											
Maximum closing moment (88°~ 92°), Nm	14,6	14,8																											
Minimum closing moment at any other angle, Nm	8,6	8,8																											
Rotating direction	CW	CCW																											
Maximum closing moment (0°~ 4°), Nm	22,0	21,9																											
Maximum closing moment (88°~ 92°), Nm	11,0	11,2																											
Minimum closing moment at any other angle, Nm	6,3	6,5																											
5.2.4	<p>Opening moment</p> <p>After 5000 test cycles the measured closing moments shall be not less than the value stated in Table 1:</p>	<table border="1"> <tr> <td>Rotating direction</td> <td>CW</td> <td>CCW</td> </tr> <tr> <td>Maximum opening moment(0°~ 60°), Nm</td> <td>31,4</td> <td>31,2</td> </tr> </table>			Rotating direction	CW	CCW	Maximum opening moment(0°~ 60°), Nm	31,4	31,2	P																		
Rotating direction	CW	CCW																											
Maximum opening moment(0°~ 60°), Nm	31,4	31,2																											
5.2.5	<p>Efficiency</p> <p>After 5000 test cycles and after 500,000 test cycles the measured efficiency shall be not less than value stated in Table 1:</p>	<p>After 5000 test cycles</p> <table border="1"> <tr> <td>Rotating direction</td> <td>CW</td> <td>CCW</td> </tr> <tr> <td>Efficiency, %:</td> <td>81,0</td> <td>79,7</td> </tr> </table> <p>After 500,000 test cycles</p> <table border="1"> <tr> <td>Rotating direction</td> <td>CW</td> <td>CCW</td> </tr> <tr> <td>Efficiency, %:</td> <td>78,2</td> <td>76,8</td> </tr> </table>			Rotating direction	CW	CCW	Efficiency, %:	81,0	79,7	Rotating direction	CW	CCW	Efficiency, %:	78,2	76,8	P												
Rotating direction	CW	CCW																											
Efficiency, %:	81,0	79,7																											
Rotating direction	CW	CCW																											
Efficiency, %:	78,2	76,8																											
5.2.6	<p>Closing time</p> <p>After 5000 test cycles and after 500,000 test cycles, the closing time, from a door opening angle of 90 degree, shall be capable of adjustment to 3 seconds or less, and 20 seconds or more. After 500,000 test cycles, the closing time set at 5000 test cycles shall not have increased by more than 100%, or decreased by more than 30 %:</p>	<p>·After 5000 test cycles: The adjustable range of closing time: 2"15 to more than 5 minutes; Setting closing time: 4"78</p> <p>·After 500,000 test cycles: Final closing time: 4"97 The adjustable range of closing time: 2"21 to more than 5 minutes.</p>			P																								

EN 1154			
Clause	Requirement – Test	Result - Remark	Verdict
5.2.7	<p>Angles of operation</p> <p>The door closer shall permit the test door to open according to its grade, and on closing, shall control the door from a minimum angle of 70 degree:</p>	<p>Maximum open angle: 150°</p> <p>The controlled angle: 135°</p>	P
5.2.8	<p>Overload performance</p> <p>The door closer shall be capable of withstanding the closing overload tests:</p>	<p>After 5000 and 500,000 cycles</p> <p>Overload weight: 21 kg</p> <p>Cycle: 5 times for each side;</p> <p>The floor spring functioned normally after overload and no visible oil leakage were found.</p>	P
5.2.9	<p>Temperature dependence</p> <p>A set closing time of 5 seconds at an ambient temperature of 20 degree C, shall not increase to more than 25 seconds or decrease to less than 3 seconds when tested at -15 degree C and 40 degree C:</p>	<p>Closing time at 20°C: 5"15</p> <p>Closing time at -15°C: 7"58</p> <p>Closing time at 40°C: 3"24</p>	P
5.2.10	<p>Fluid leakage</p> <p>Throughout the test programme there shall be no leakage of fluid from the door closer:</p>	Not found any fluid leakage throughout the test	P
5.2.11	<p>Damage</p> <p>Throughout the test programme there shall be no damage to the door closer or its arms that would adversely affect its performance to this standard:</p>	Not found any damage throughout the test	P
5.2.12	<p>Latch control (optional)</p> <p>Accelerated closing shall be effective over a maximum range of 15 degree from the closed position, and shall be adjustable</p>	Latch control could be adjustable to enable accelerated closing controlled angle 0° to 15°	P
5.2.13	<p>Backcheck (optional)</p> <p>The door closer shall be capable of arresting the test door before 90 degree position:</p>	No backcheck function	N/A
5.2.14	<p>Delay closing (optional)</p> <p>The delay time shall not be less than 20 seconds.</p> <p>The delay zone shall not extend below the 65 degree open position.</p> <p>The moment required to override manually the delay action shall not exceed 150 Nm.</p> <p>The delay time at the conclusion of 500 test cycles shall be between 10 seconds to 30 seconds:</p>	No delayed closing function	N/A

EN 1154																														
Clause	Requirement – Test	Result - Remark	Verdict																											
5.2.15	Adjustable closing force (optional) If provided with an adjustable closing function, the door closer shall comply with the performance at both the minimum and maximum power settings claimed by manufacture:	Fixed closing force door closer	N/A																											
5.2.16	Zero position (for double action door closers only) The amount of free play at the zero position of a new door closer shall not exceed 3 mm, and after 500,000 test cycles shall not exceed 6 mm:	Before test, the measured free play is 1,7mm; After 500 000 test cycles, measured free play is 2,30mm	P																											
5.2.17	Corrosion resistance The requirement shall be according to EN 1670. The closing moment of the door closer shall be not less than 80% of the closing moment measured prior to the test. The acceptance conditions of EN 1670 shall be met for all surfaces of the door closer which are visible:	Before corrosion test <table border="1"> <tr> <td>Rotating direction:</td> <td>CW</td> <td>CCW</td> </tr> <tr> <td>Maximum closing moment (0°~4°), Nm</td> <td>22,0</td> <td>22,1</td> </tr> <tr> <td>Maximum closing moment (88°~92°), Nm</td> <td>13,1</td> <td>13,6</td> </tr> <tr> <td>Minimum closing moment at any other angle, Nm</td> <td>8,1</td> <td>8,1</td> </tr> <tr> <td colspan="3">After 240 hours corrosion test</td> </tr> <tr> <td>Rotating direction:</td> <td>CW</td> <td>CCW</td> </tr> <tr> <td>Maximum closing moment (0°~4°), Nm</td> <td>20,2</td> <td>20,4</td> </tr> <tr> <td>Maximum closing moment (88°~92°), Nm</td> <td>12,4</td> <td>12,5</td> </tr> <tr> <td>Minimum closing moment at any other angle, Nm</td> <td>6,9</td> <td>7,0</td> </tr> </table>	Rotating direction:	CW	CCW	Maximum closing moment (0°~4°), Nm	22,0	22,1	Maximum closing moment (88°~92°), Nm	13,1	13,6	Minimum closing moment at any other angle, Nm	8,1	8,1	After 240 hours corrosion test			Rotating direction:	CW	CCW	Maximum closing moment (0°~4°), Nm	20,2	20,4	Maximum closing moment (88°~92°), Nm	12,4	12,5	Minimum closing moment at any other angle, Nm	6,9	7,0	P
Rotating direction:	CW	CCW																												
Maximum closing moment (0°~4°), Nm	22,0	22,1																												
Maximum closing moment (88°~92°), Nm	13,1	13,6																												
Minimum closing moment at any other angle, Nm	8,1	8,1																												
After 240 hours corrosion test																														
Rotating direction:	CW	CCW																												
Maximum closing moment (0°~4°), Nm	20,2	20,4																												
Maximum closing moment (88°~92°), Nm	12,4	12,5																												
Minimum closing moment at any other angle, Nm	6,9	7,0																												
5.2.18	Fire/smoke door suitability A door closer for use on a fire/smoke door assembly shall meet the necessary requirements of Annex A.....	Grade 0	N/A																											

*****End of page*****

Appendix A

Product photo



Appendix B

Product drawing and bill of material

Rev	Date	By	Check
1.0	13/11/2013	WJ	WJ
1.1	13/11/2013	WJ	WJ
1.2	13/11/2013	WJ	WJ
1.3	13/11/2013	WJ	WJ
1.4	13/11/2013	WJ	WJ
1.5	13/11/2013	WJ	WJ
1.6	13/11/2013	WJ	WJ
1.7	13/11/2013	WJ	WJ
1.8	13/11/2013	WJ	WJ
1.9	13/11/2013	WJ	WJ
1.10	13/11/2013	WJ	WJ
1.11	13/11/2013	WJ	WJ
1.12	13/11/2013	WJ	WJ
1.13	13/11/2013	WJ	WJ
1.14	13/11/2013	WJ	WJ

Item No.	Part Name	Spec	Quantity	Item No.	Part Name	Spec	Quantity
1	木體	#15-11	1	15	密封墊圈	#1510	1
2	螺塞	#26x7.2L	1	16	密封墊圈	#1010	1
3	安全釋放螺絲	#11.3x15.5L	1	17	螺絲	P15	1
4	彈簧	S7	1	18	彈簧	#26x#2	3
5	螺絲	3/16"	1	19	螺絲	#30.7x15L	1
6	螺絲	#2.9x10L	1	20	螺絲	#5.5x110	1
7	螺絲	#12.3x9.7L	1	21	螺絲	#3.2x110L	1
8	螺絲	#2x9.7L	1	22	螺絲	#30.7x11.2L	2
9	螺絲	#7x22.5L	1	23	螺絲	1/8"	2
10	螺絲	#13.7x11L	2	24	螺絲	M6x20L	2
11	螺絲	#2x9.5L	14	25	螺絲	P4	2
12	螺絲	#2x10L	1	26	螺絲	#13.9x11	1
13	螺絲	#2.8x5.2	1	27	螺絲	#8.3x2L	2
14	螺絲	#15-#10x61.5L	1	28	螺絲	#2.4x110	1

Without hold-open

Rev	Date	By	Check
1.0	13/11/2013	WJ	WJ
1.1	13/11/2013	WJ	WJ
1.2	13/11/2013	WJ	WJ
1.3	13/11/2013	WJ	WJ
1.4	13/11/2013	WJ	WJ
1.5	13/11/2013	WJ	WJ
1.6	13/11/2013	WJ	WJ
1.7	13/11/2013	WJ	WJ
1.8	13/11/2013	WJ	WJ
1.9	13/11/2013	WJ	WJ
1.10	13/11/2013	WJ	WJ
1.11	13/11/2013	WJ	WJ
1.12	13/11/2013	WJ	WJ
1.13	13/11/2013	WJ	WJ
1.14	13/11/2013	WJ	WJ

Item No.	Part Name	Spec	Quantity	Item No.	Part Name	Spec	Quantity
1	木體	#15-11	1	15	密封墊圈	#1510	1
2	螺塞	#26x7.2L	1	16	密封墊圈	#1010	1
3	安全釋放螺絲	#11.5x15.5L	1	17	螺絲	P15	1
4	彈簧	S7	1	18	彈簧	#26x#2	3
5	螺絲	3/16"	1	19	螺絲	#30.7x15L	1
6	螺絲	#2.9x10L	1	20	螺絲	#5.5x110	1
7	螺絲	#12.3x9.7L	1	21	螺絲	#3.2x110L	1
8	螺絲	#2x9.7L	1	22	螺絲	#30.7x11.2L	2
9	螺絲	#7x22.5L	1	23	螺絲	1/8"	2
10	螺絲	#13.7x11L	2	24	螺絲	M6x20L	2
11	螺絲	#2x9.5L	14	25	螺絲	P4	2
12	螺絲	#2x10L	1	26	螺絲	#13.9x11	1
13	螺絲	#2.8x5.2	1	27	螺絲	#8.3x2L	2
14	螺絲	#15-#10x61.5L	1	28	螺絲	#2.4x110	1

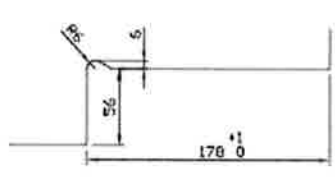
With hold-open

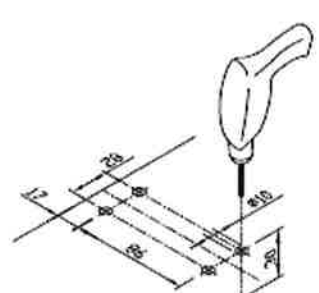
Appendix C


Installation instruction

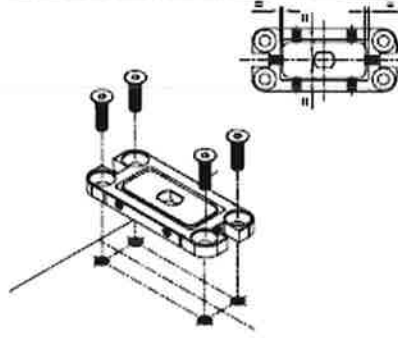
78 CONCEAL FLOOR HINGE INSTALLATION INSTRUCTION 1/2

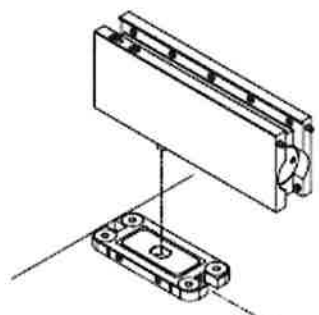
Glass Cutout

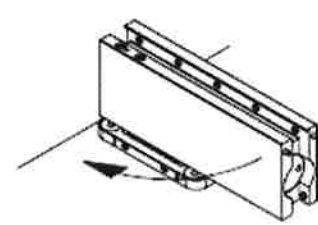
1  Units : mm

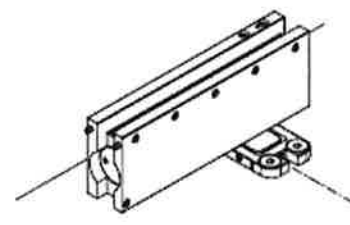
2  Units : mm

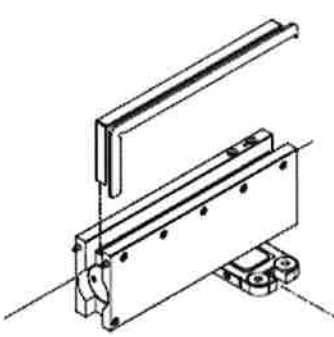
3 

4 

5 

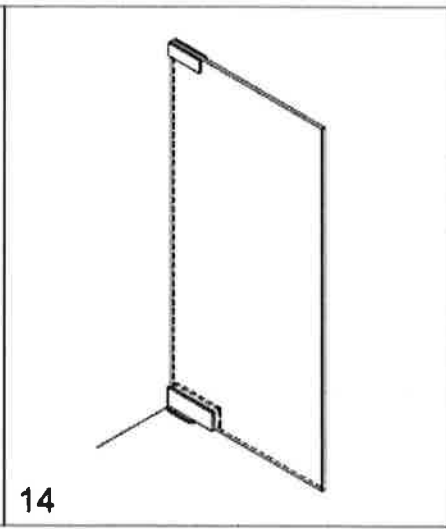
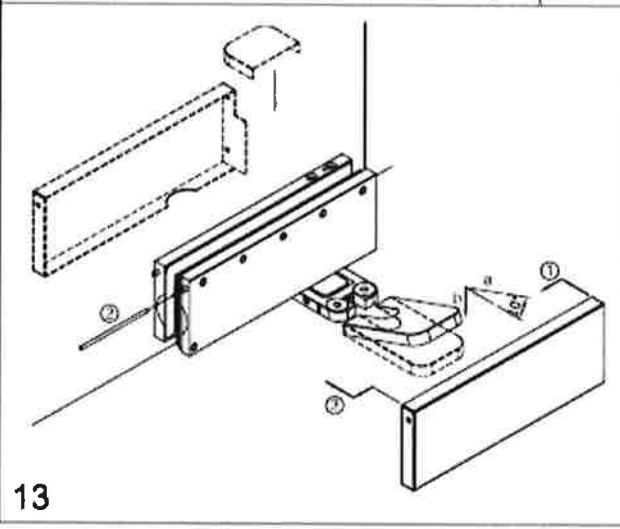
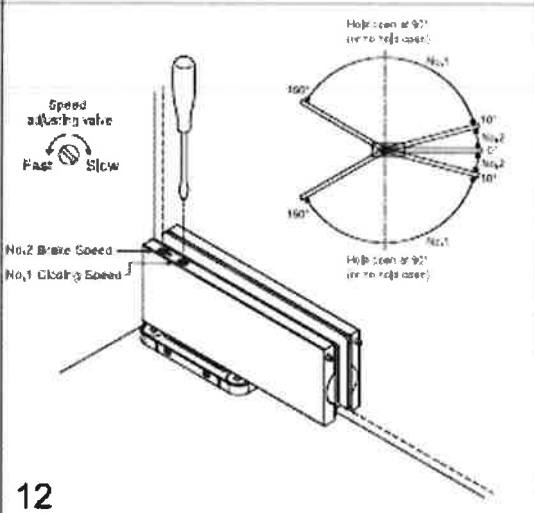
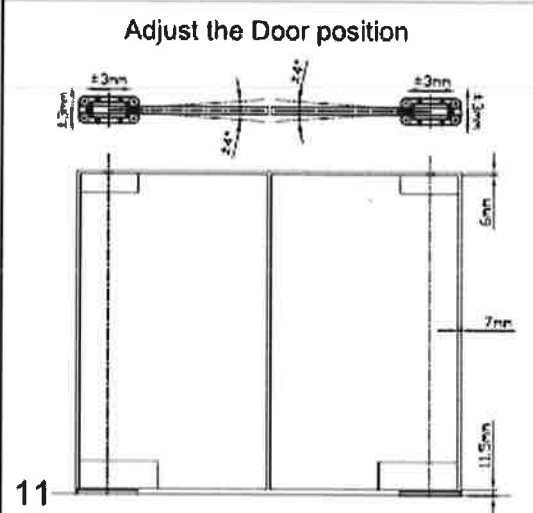
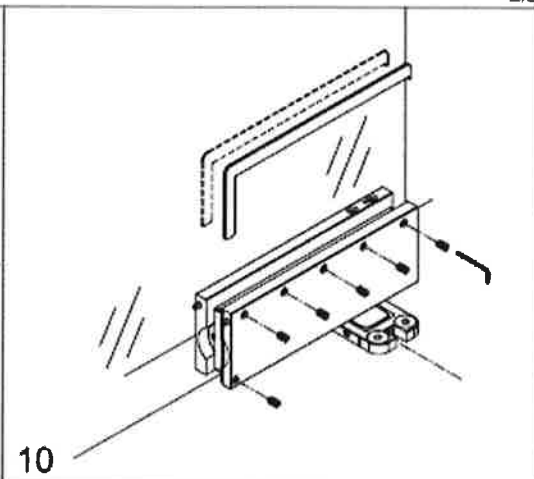
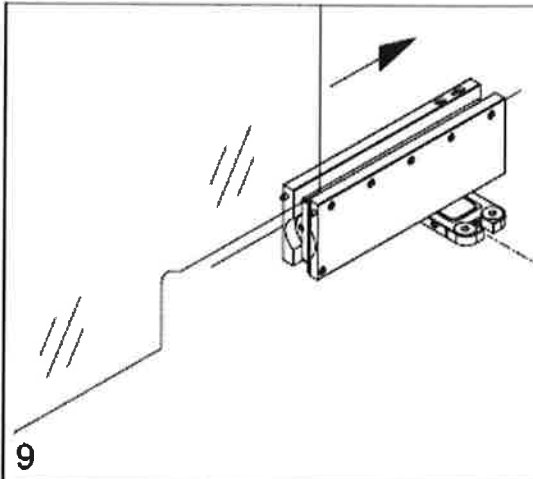
6 

7 

8 

CONCEAL FLOOR HINGE INSTALLATION INSTRUCTION

2/2



*****End of Page*****

Revision Page

Revision No.	Date	Changes	Author	Reviewer
0	July 5, 2013	First issue	Alan Lai	Blusea Dong

*****End of Report*****